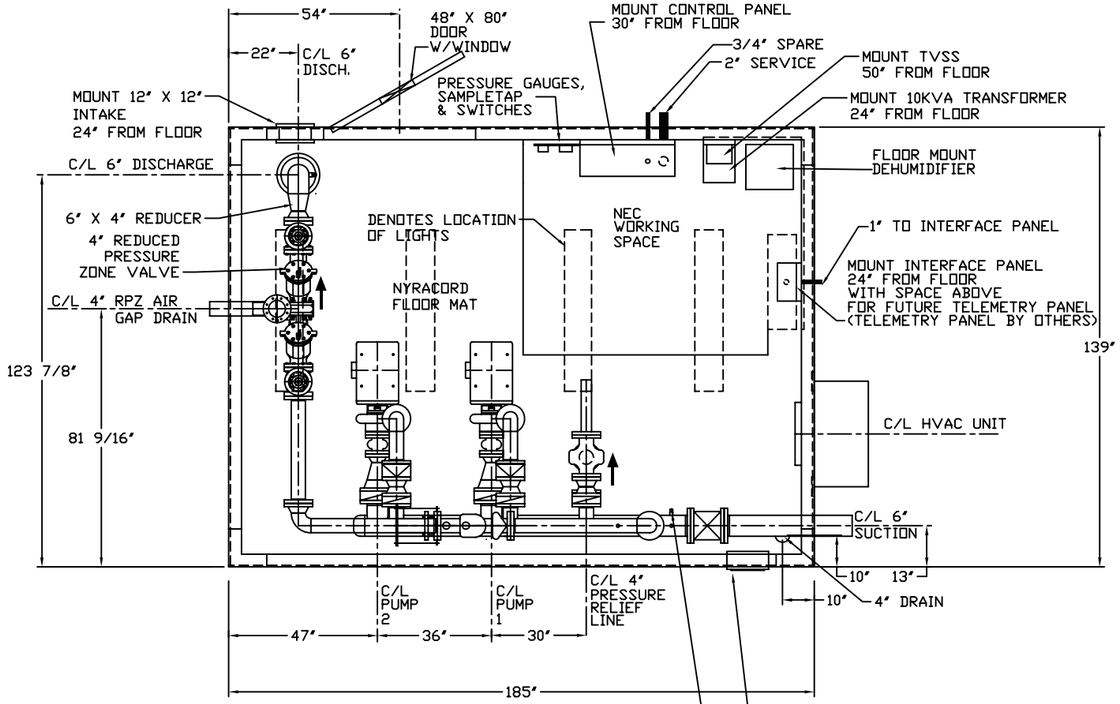

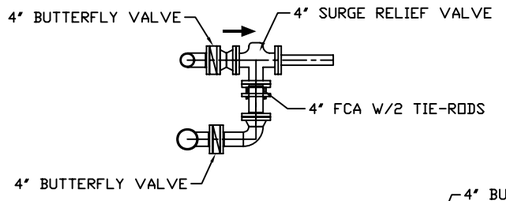

4' PRESSURE RELIEF LINE

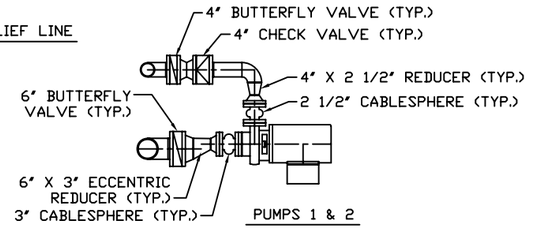

PUMPS 1 & 2

PAINT REQUIREMENTS:
APPLY 8 MILS EPOXY ENAMEL
INTERIOR OF PIPING
FUSION BONDED EPOXY COATED PER C213

CONDUITS REQUIRED:

2' SERVICE
1' TELEMETRY TO INTERFACE PANEL
3/4' SPARE

CONDUITS THROUGH WALL OF STATION

SUGGESTED CONCRETE SLAB LAYOUT

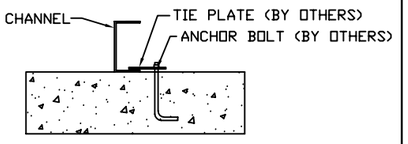

ANCHOR SYSTEM

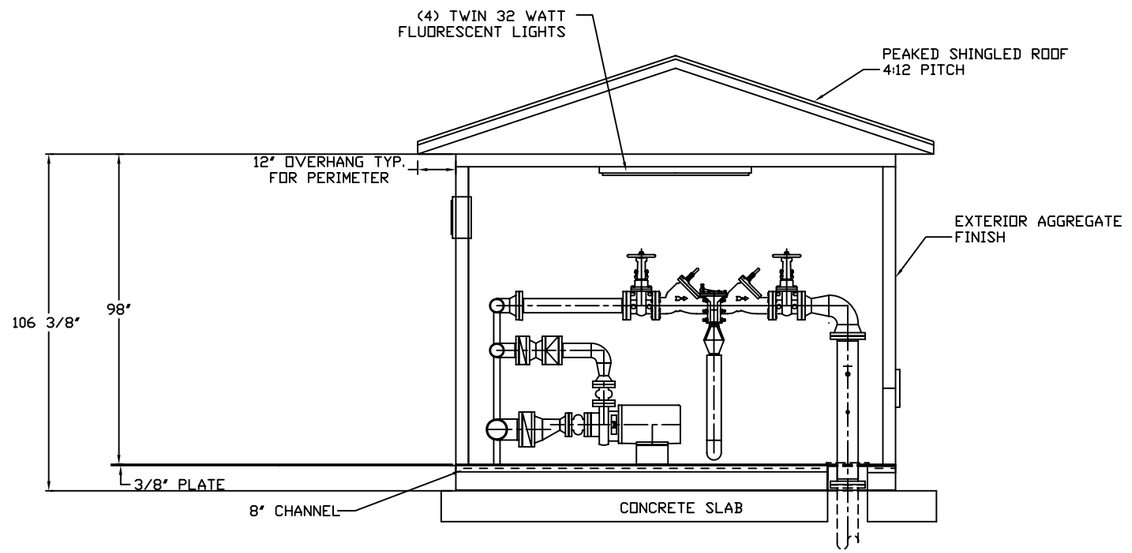

NOTE:
PIPE EXTERNAL TO STATION MUST BE INDEPENDENTLY SUPPORTED.

0' 6' 12' 24' 36' 48' 60'

REV. NO.	REVISION	BY CHK'D	DATE

DESIGNED BY:	DATE
DRAWN BY: TRM	DATE 10/8
CHECKED BY: W.K.	DATE 07
SCALE	

USEMCO

USEMCO INCORPORATED

P.O. BOX 550 (608) 372-5911 TOMAH WI. 54660

DESCRIPTION

MOUNT CRAWFORD, VA (HARRISONBURG)

DWG. NO.

JOB NO. 7195